


004 – Schematic Layout (Direct and Indirect)


Firetrace[®] Direct System

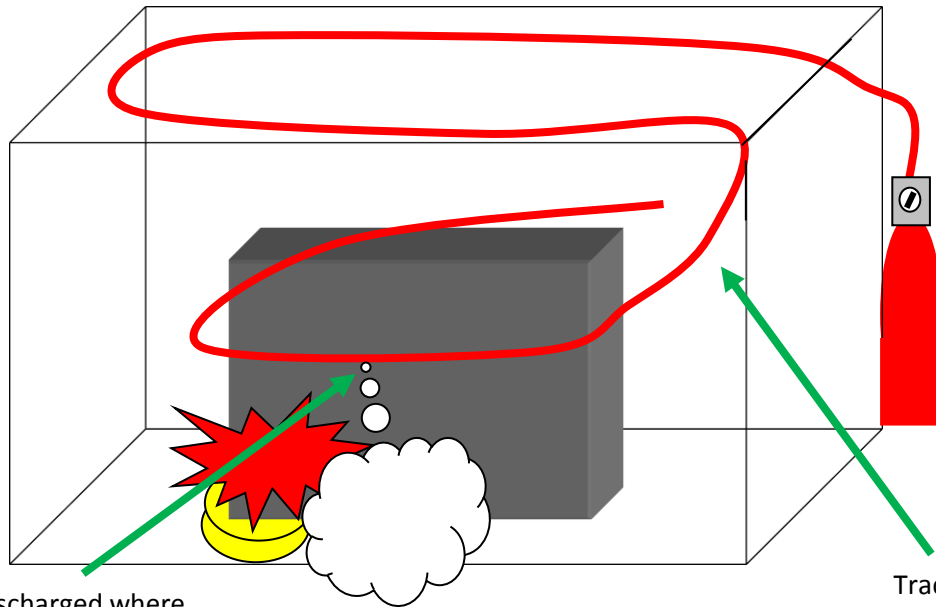

Extinguishant discharged where rupture occurs

Tracetube located around risk area

Firetrace[®] Indirect System

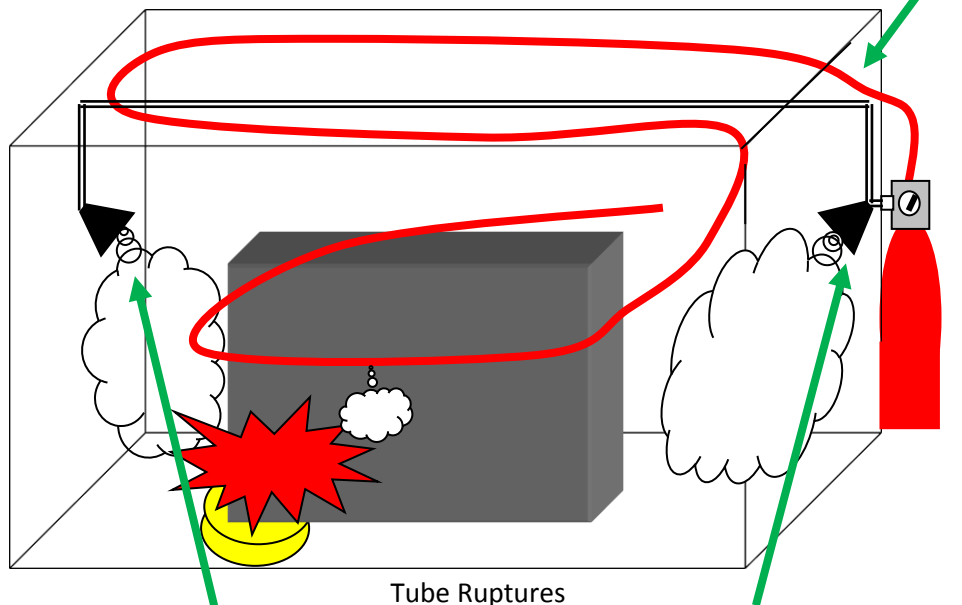

Tube Ruptures

Extinguishant discharges through pipe work and diffusers when rupture occurs

